


500-1501

B

REV NO.	LET	REVISION	ZONE OR ENG CDR	DATE
		SP3D SAME DWG, NO CHGS., SAME NO. 'A' SIZE		
		DATED 10-15-74		
63064	B	1 RMY S/S-SH ADD CONTROL BOX	4C DA 7/72 DA	7-23-93

V.O. DRAWING

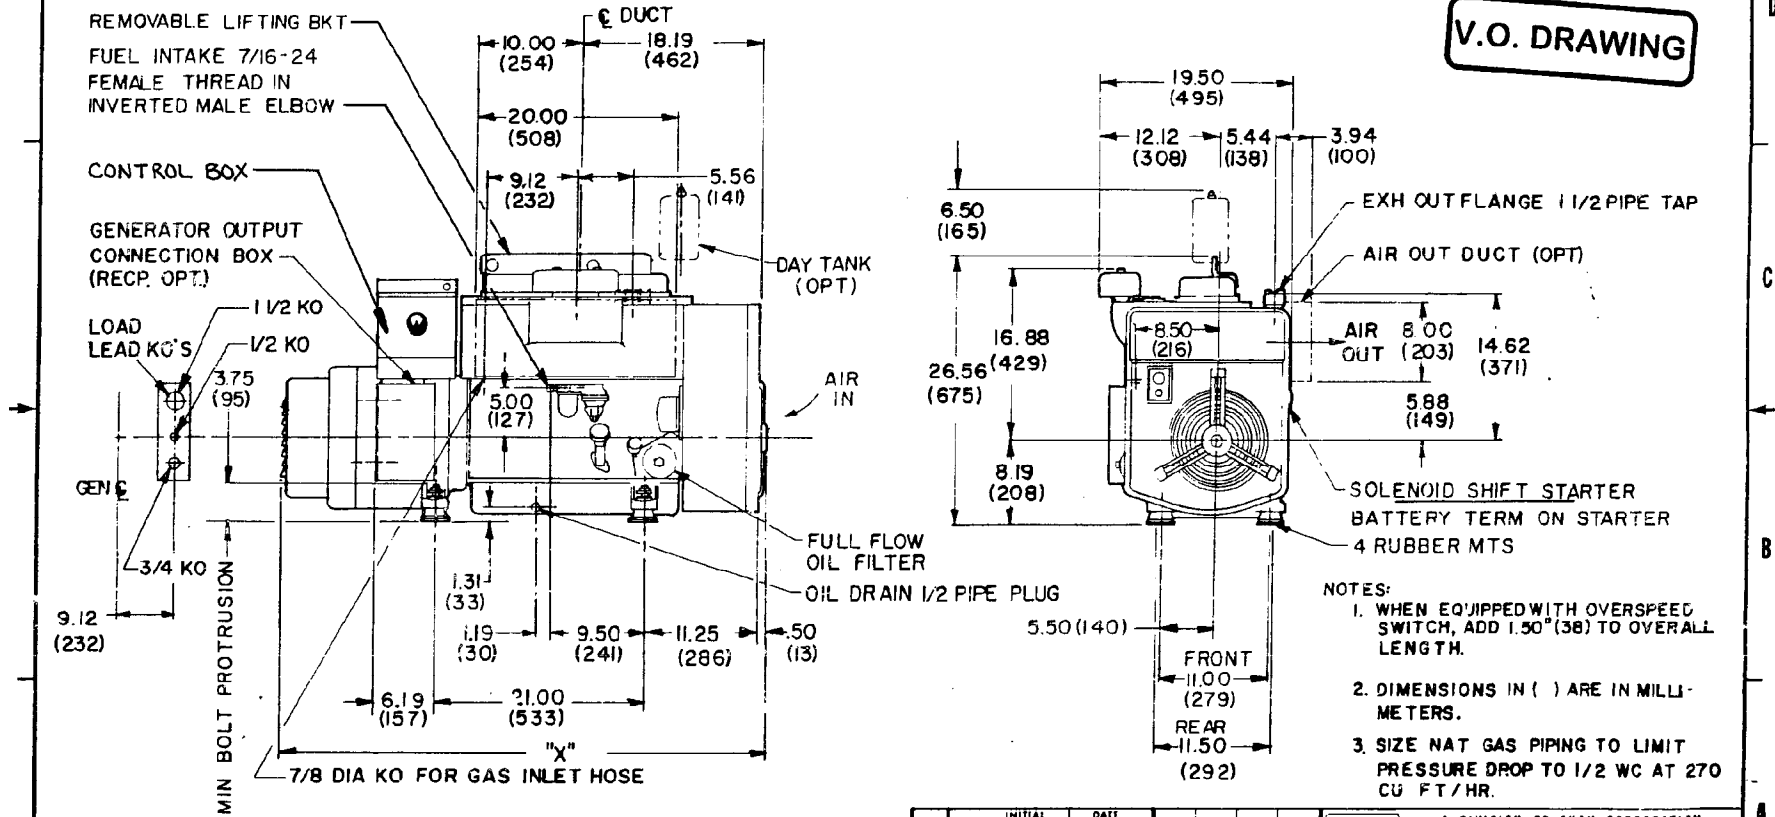

- NOTES:
1. WHEN EQUIPPED WITH OVERSPEED SWITCH, ADD 1.50" (38) TO OVERALL LENGTH.
 2. DIMENSIONS IN () ARE IN MILLI-METERS.
 3. SIZE NAT GAS PIPING TO LIMIT PRESSURE DROP TO 1/2 WC AT 270 CU FT/HR.

MODEL	KW RATING	GEN. OUTPUT	STARTING	LBS (KG)	DIM "X"
12.5 JC	10 CONT, 12.5 STANDBY	10 1.0 PF	REMOTE	667 (302)	46.8 (1189)
12.5 JC	10 CONT, 12.5 STANDBY	30 0.8 PF	REMOTE	672 (305)	46.8 (1189)
15 JC	10 CONT, 15 STANDBY	10 1.0 PF	REMOTE	677 (307)	47.5 (1206)
15 JC	10 CONT, 15 STANDBY	30 0.8 PF	REMOTE	682 (309)	47.5 (1206)

INITIAL	DATE
OR RIA	7-9-77
CKR	8-10-77
ENGR	3/1/77
SEMA	
FROM	1/3/32=1

A DIVISION OF OMAN CORPORATION
Minneapolis, Minnesota

OUTLINE-INSTALLATION

12.5 & 15 JC (YD)

500-1501

DWG SIZE B

FORM 80077

HUNTSVILLE