



SOUTH

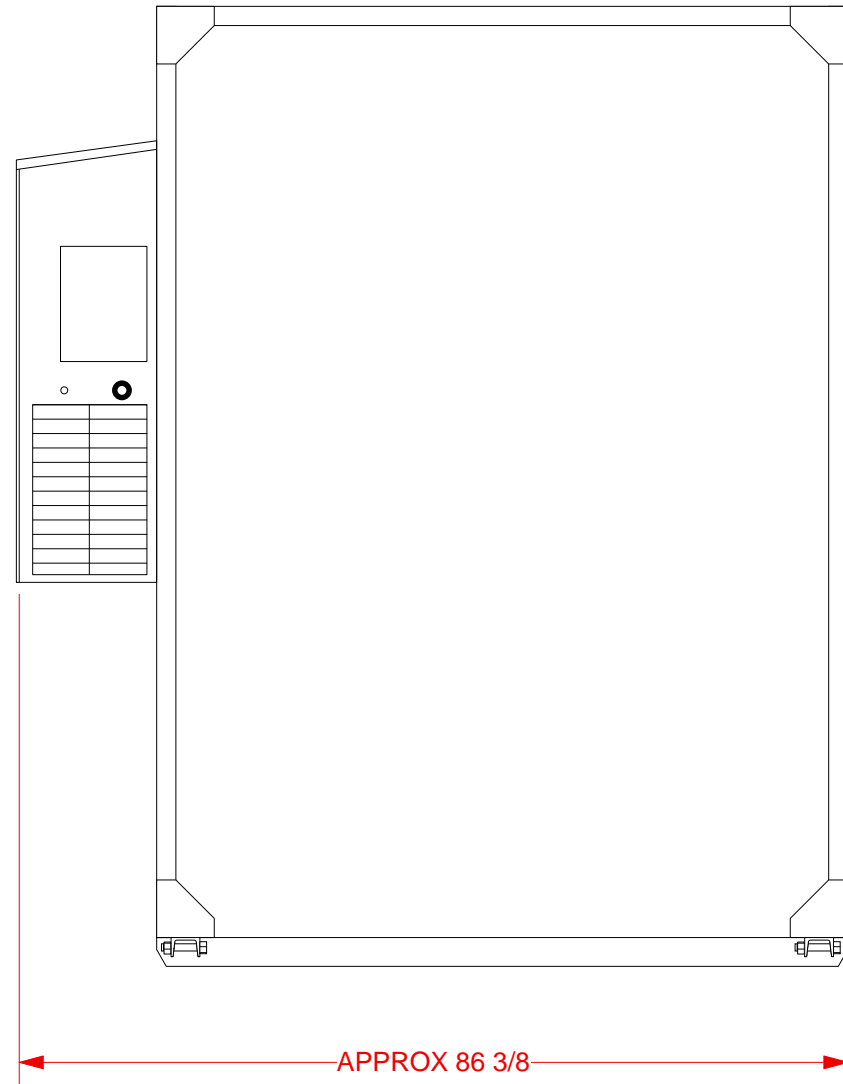


EAST

REV	DESCRIPTION	DATE	BY	DWN	TES	DATE	12/7/98	 SHELTER 5890 EQUIPMENT DRIVE GRANTS PASS, OR 97526	TITLE	EXTERIOR ELEVATIONS	DATE:	12/7/98	DWG NO:	CI-0001-980032	REV:	N/C	APPROVED:
				CHKD		DATE			JOB:	980032 KVB-ENERTEC	SCALE:	1:2	SHEET:	2 OF 2	SIZE		B
				APVD		DATE						0					

CONSTRUCTION NOTES:

1. FRAME: FULLY WELDED TUBULAR STEEL
2. INSULATION: R-11 EPS FOAM.
3. EXTERIOR: WHITE ALUMINUM EXTERIOR SKINS WITH ALUMINUM CORNERS AND EDGE MOLDINGS.
4. ROOF: ATACTIC POLYPROPYLENE SYSTEM.
5. SOLID CORE EXTERIOR DOOR, 2-6 X 7-0 WITH FIXED-PIN STAINLESS STEEL HINGES, TEMPERED GLASS WINDOW, AUTOMATIC CLOSER AND DRIP CAP.
6. PANIC BAR HARDWARE WITH EXTERIOR THUMB LATCH.
7. INTERIOR WALLS: PREFINISHED WOOD PANELING, WHITE CEILING.
8. FINISHED FLOOR: HIGH-WEAR SOLID VINYL TILE WITH COORDINATING RUBBER BASE COVE.
9. ELECTRICAL SYSTEM, CONSISTING OF:
 - 30 POSITION LOAD CENTER, 150 A, 240-120 VAC, 3 Ø,
 - FULL PERIMETER 4" X 4" WIREWAY AT CEILING (NO HIDDEN WIRING),
 - (3) STANDARD NEMA 5-20 DUPLEX RECEPTACLES,
 - (1) FLUORESCENT LIGHT FIXTURES, 2 X 40 W EACH,
10. AIR CONDITIONER: 1-TON WALL MOUNT HVAC UNIT,
11. HEAT: 4 KW RESISTANCE HEATER IN HVAC.
12. ALL TOLERANCES ±1/8" UNLESS OTHERWISE NOTED.

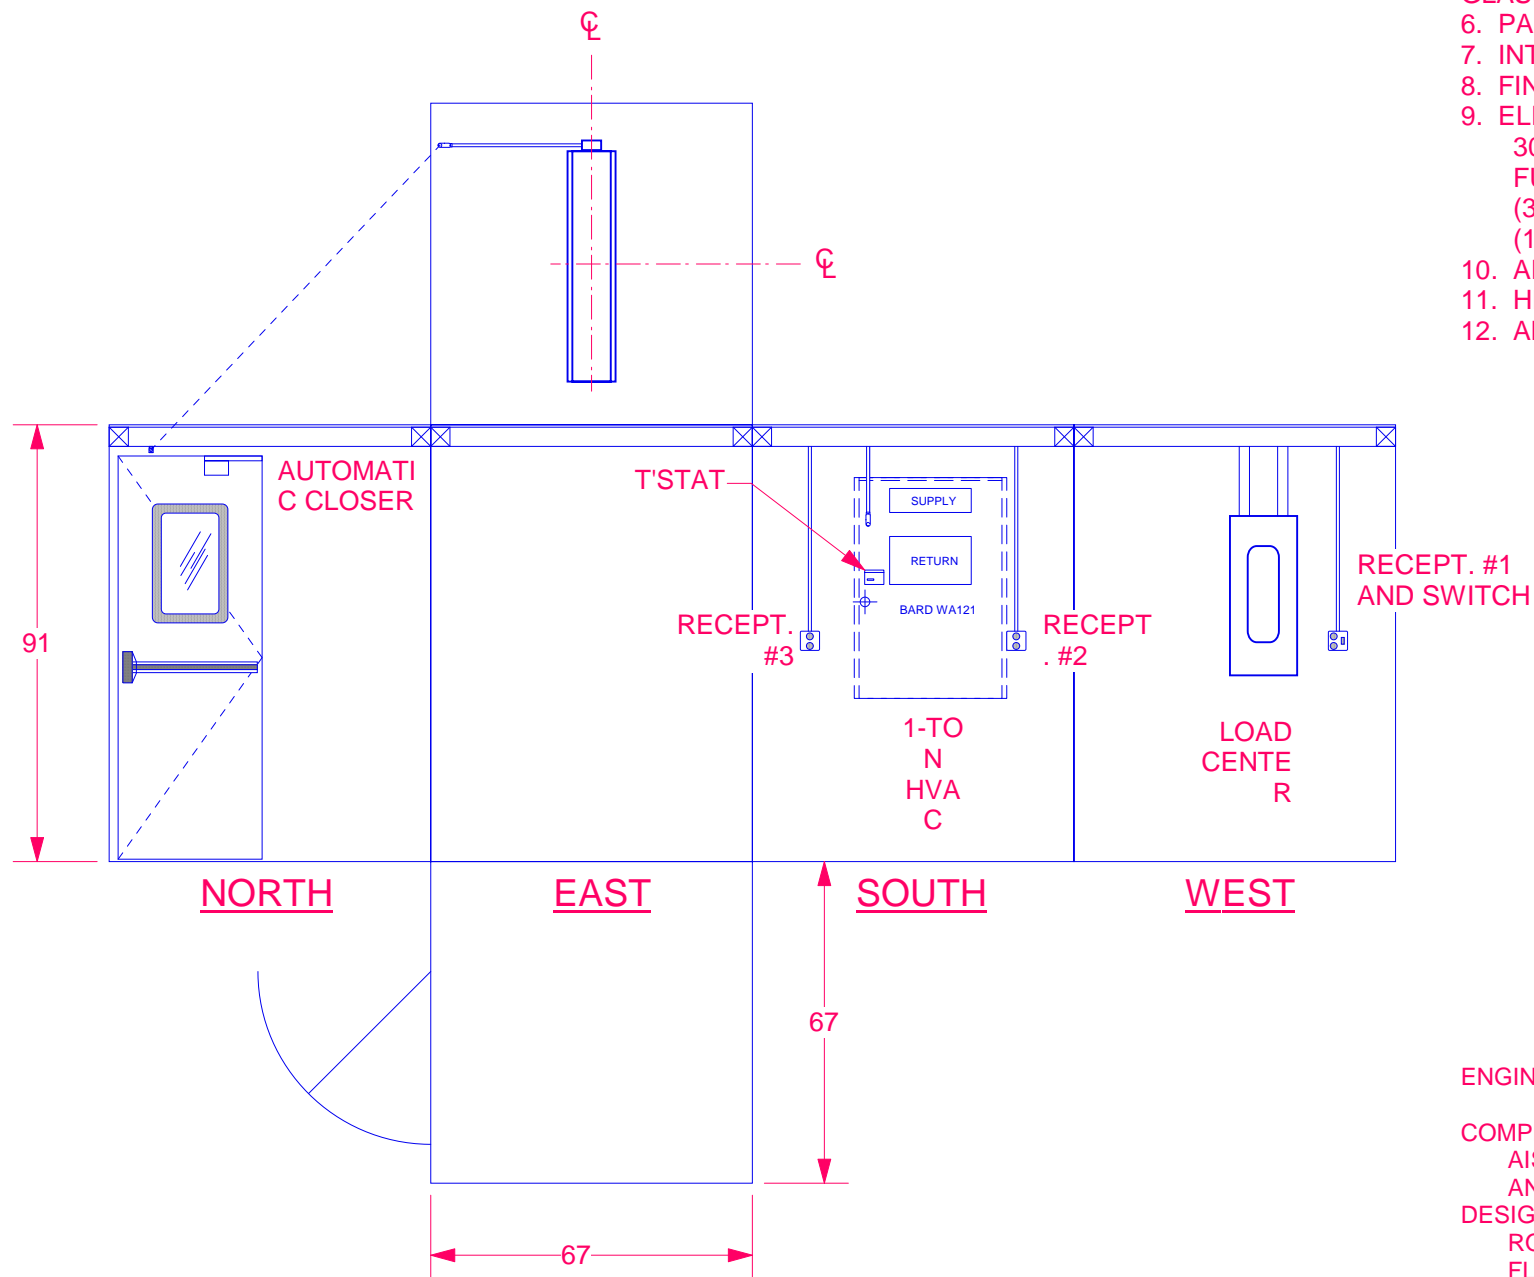



ENGINEERING:

COMPLIES WITH APPLICABLE STANDARDS OF ICBO, BOCA, SBCCI, AISC, AND ASTM. ALL STRUCTURAL WELDING COMPLIES WITH ANSI/AWS D1.1-96 "STRUCTURAL WELDING CODE, STEEL"


DESIGN LOADS:

- ROOF: 70 PSF.
- FLOOR: 120 PSF.
- WIND: 37 PSF (EQUIVALENT TO 120 MPH WIND)
- SEISMIC: ZONE 3, UBC (WITH PROPER ATTACHMENT TO FOUNDATION)

REV	DESCRIPTION	DATE	BY	DWN	TES	DATE	12/7/98	 <p>SHELTER ONE 5888 SHILOH AVENUE GRANTS PASS, OR 97526</p>	TITLE	DATE:	DWG NO:	REV:	APPROVED:
A	MOVE HVAC ON SHELTERS 3 THRU 8, WAS CENTERED (SHELTERS 1 & 2)	12/16/98	TES	CHKD		DATE			INTERIOR AND ELECTRICAL LAYOUT	12/16/98	CI-0015-980032	A	
				APVD		DATE			JOB:	SCALE:	SHEET:	SIZE	
								980032 KVB-ENERTEC	1:40	1 OF 1	B		

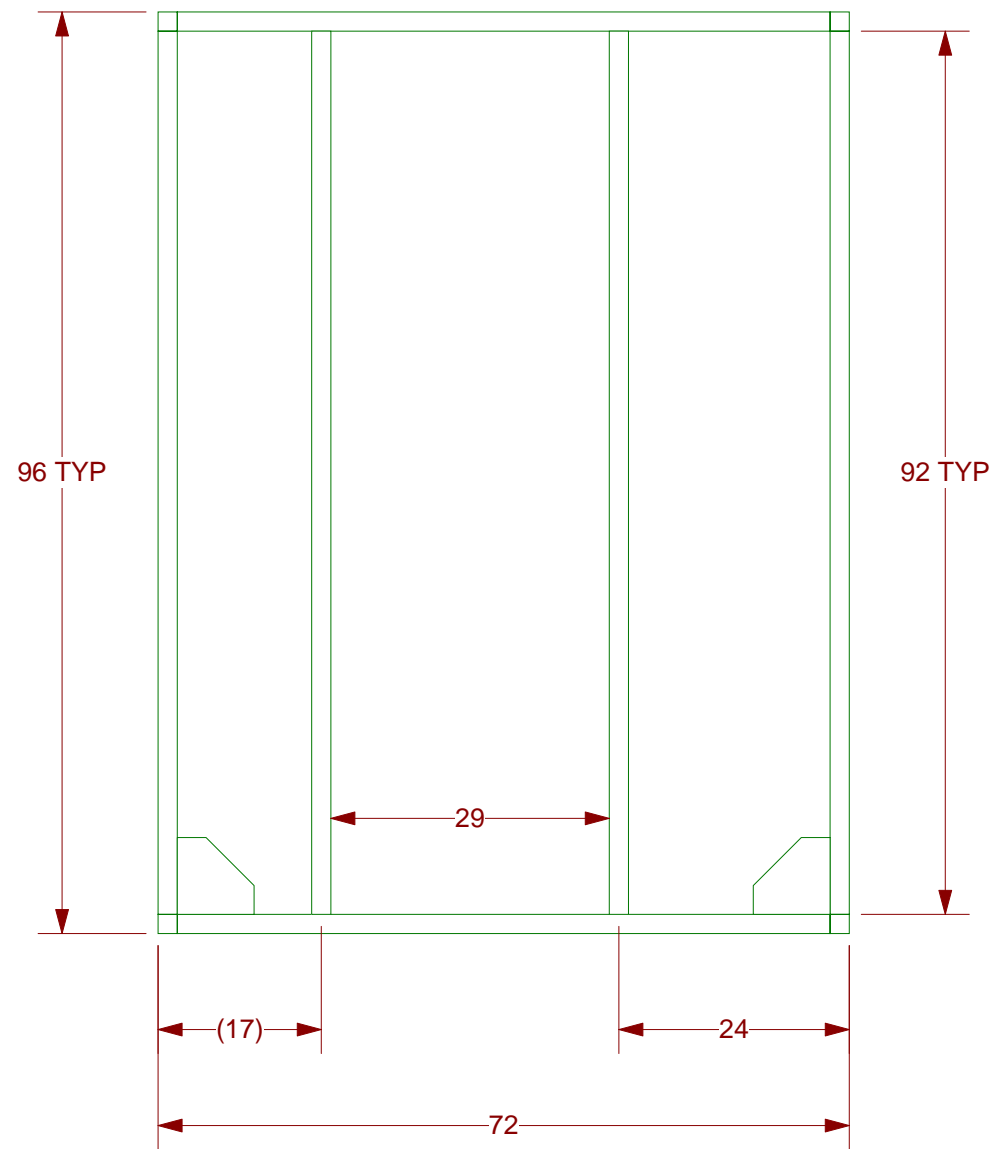


SOUTH

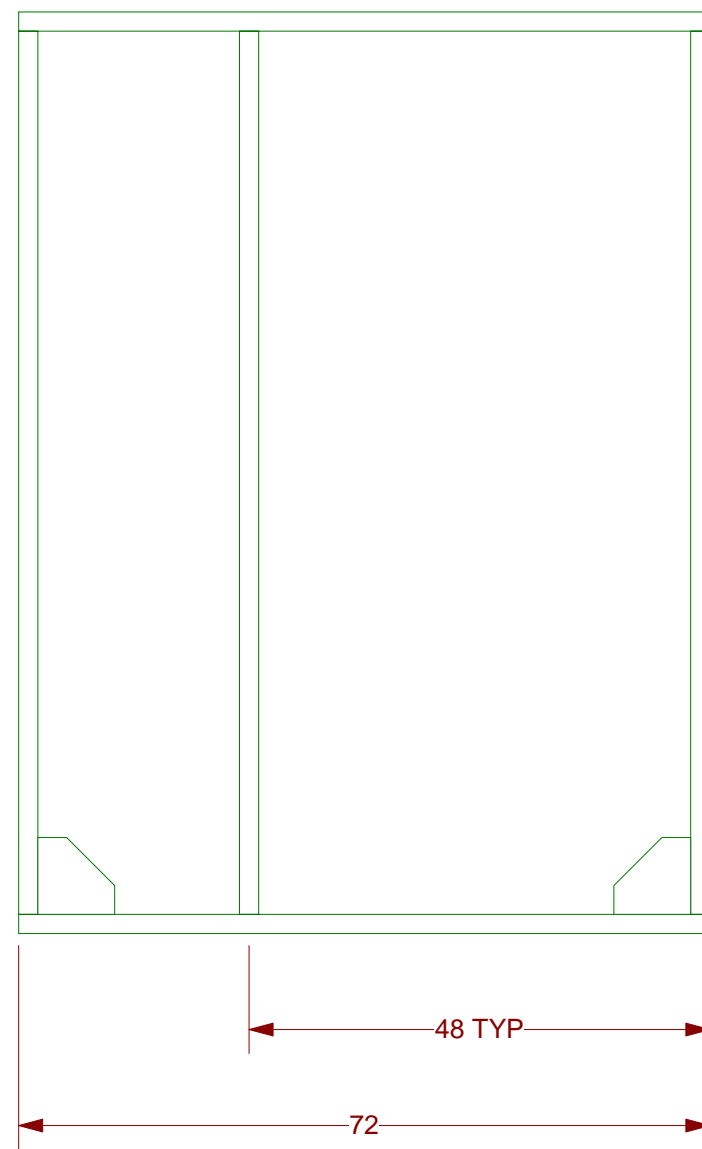


EAST

REV	DESCRIPTION	DATE	BY	DWN	TES	DATE	12/7/98		TITLE	CUSTOM FRAME	DATE:	12/16/98	DWG NO:	CF-0012-980032	REV:	A	APPROVED:	
				CHKD		DATE			JOB:	980032 KVB-ENERTEC	SCALE:	1:2	SHEET:	2 OF 3	SIZE		B	
				APVD		DATE						0						


DOOR
(SHELTER NORTH)

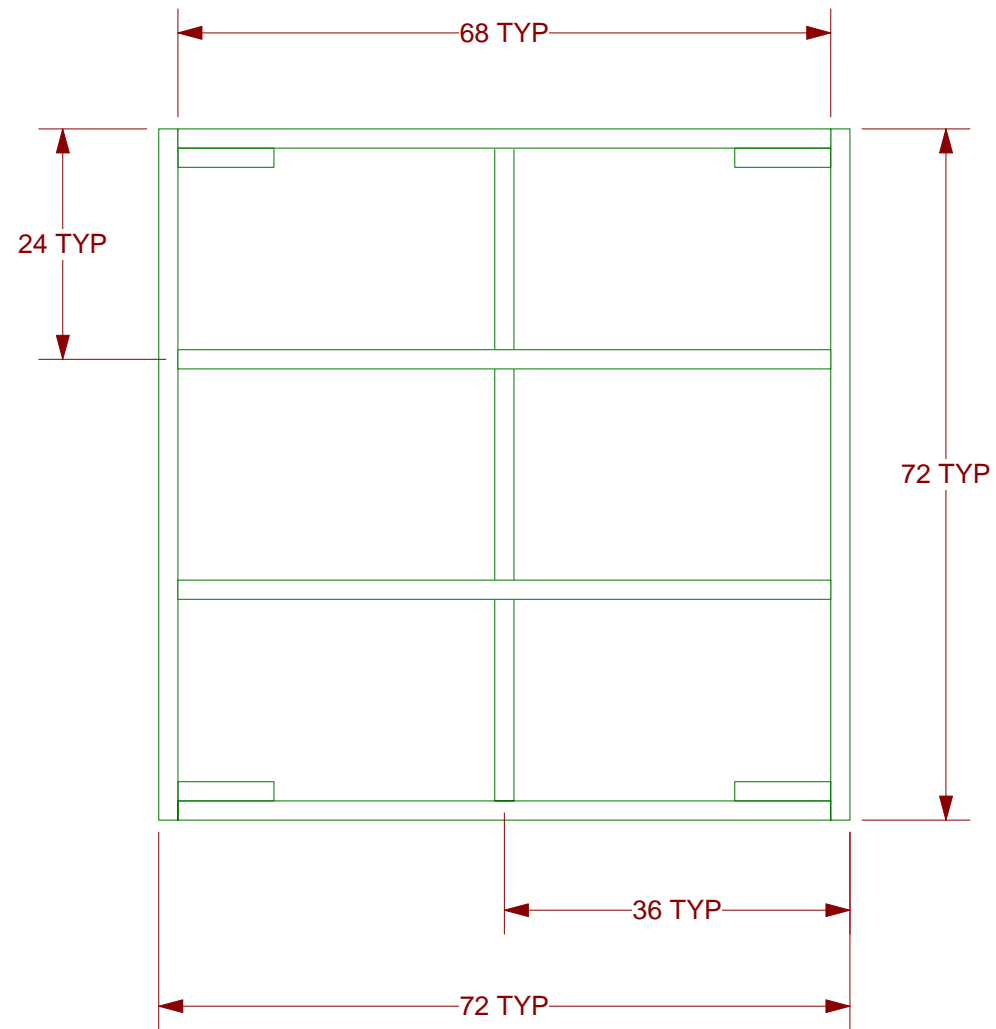

FLOOR FRAME

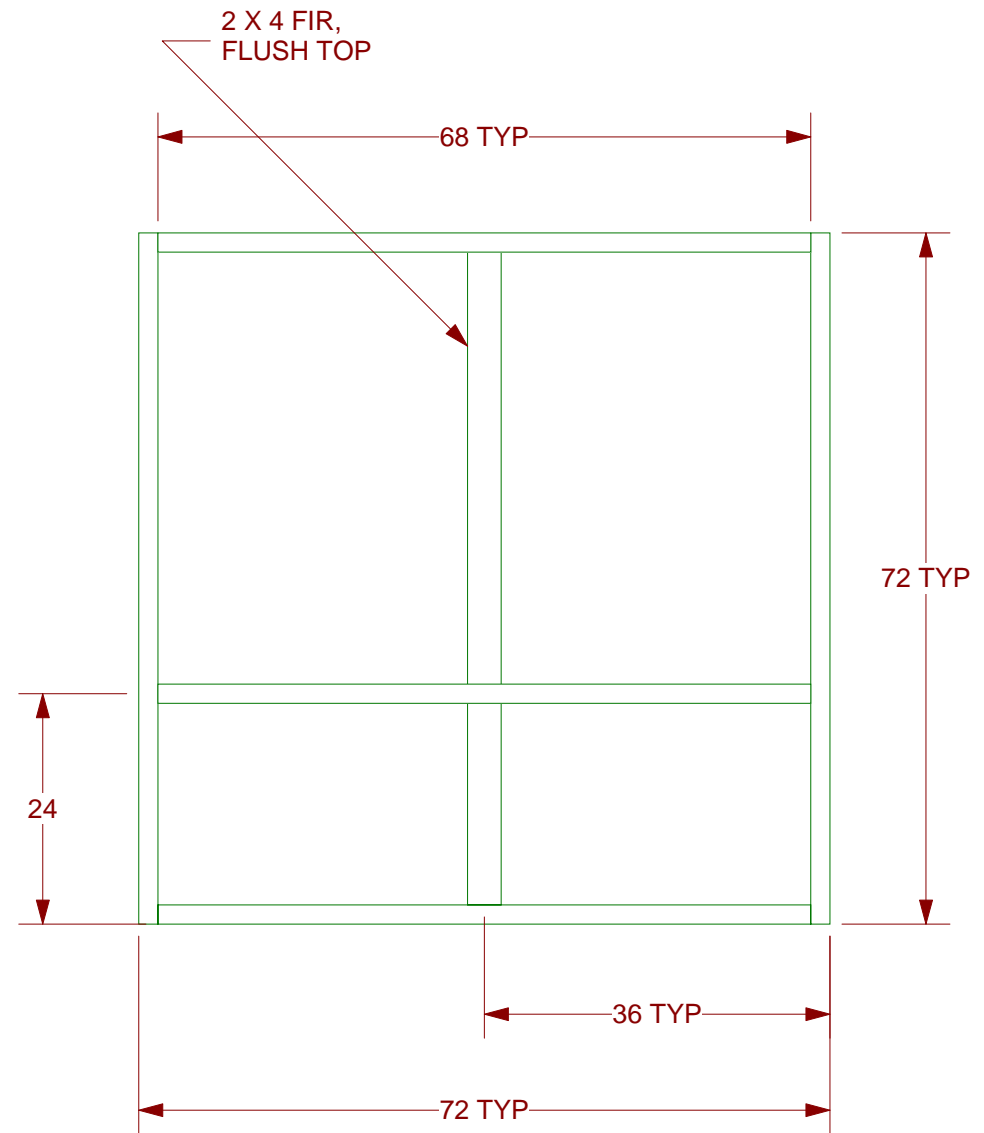

ROOF FRAME

REV	DESCRIPTION	DATE	BY	DWN	TES	DATE	12/7/98	 SHELTER ONE MILLER DRIVE GRANTS PASS, OR 97526	TITLE	CUSTOM FRAME	DATE:	12/16/98	DWG NO:	CF-0012-980032	REV:	A	APPROVED:	
				CHKD		DATE			JOB:	980032 KVB-ENERTEC	SCALE:	1:2	SHEET:	3 OF 3	SIZE		B	
				APVD		DATE					0							